

# Water System Inspection Record *Template*

Name and address of farm: \_\_\_\_\_


See farm policy for specific water distribution system inspection procedures.

Date	Time	Water Source and/or Distribution System	Observations	Corrective Actions Taken	Initials
4/22/16	7:00 AM	Well 1, north field	Well casing in good shape, backflow prevention device in place, no broken pipes	None	EAB
4/22/16	9:00 AM	Pond, south field	Significant geese presence	Introduced swan decoys. Will monitor	EAB

Reviewed by: \_\_\_\_\_ Title: \_\_\_\_\_ Date: \_\_\_\_\_

## FSMA PSR reference § 112.50(b)(1) Confidential Record

Modified from On-Farm Decision Tree Project: Agricultural Water for Production—v4 07/17/2014  
 E.A. Bihn, M.A. Schermann, A.L. Wszelaki, G.L. Wall, and S.K. Amundson, 2014 www.gaps.cornell.edu

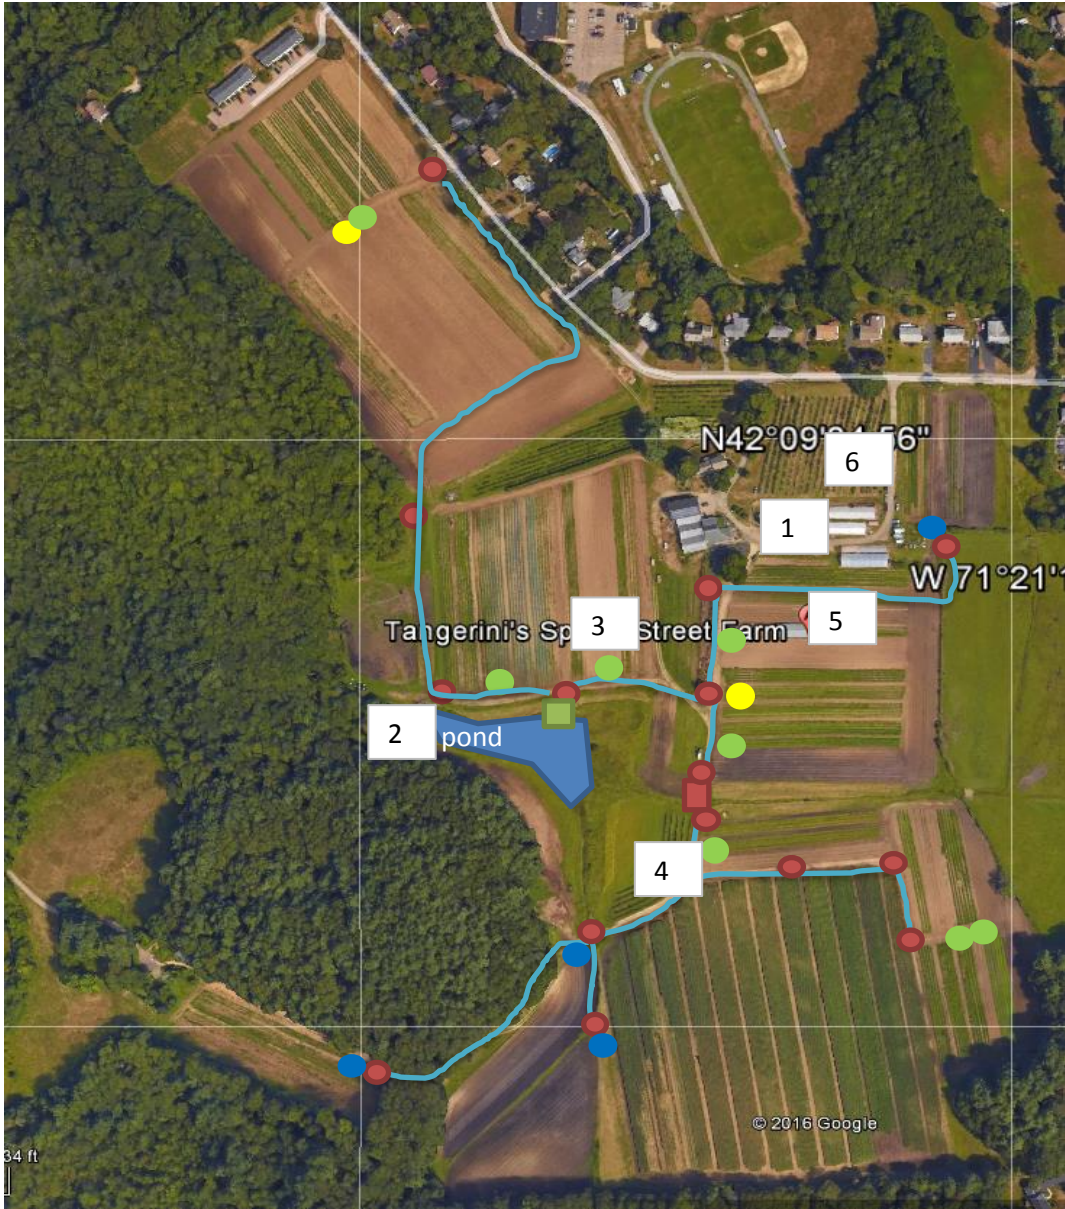

Hydrant



Brook crossing



Pump Station



4 inch buried line



Gravity drain

